



LEVEL 1

Lindau Lane

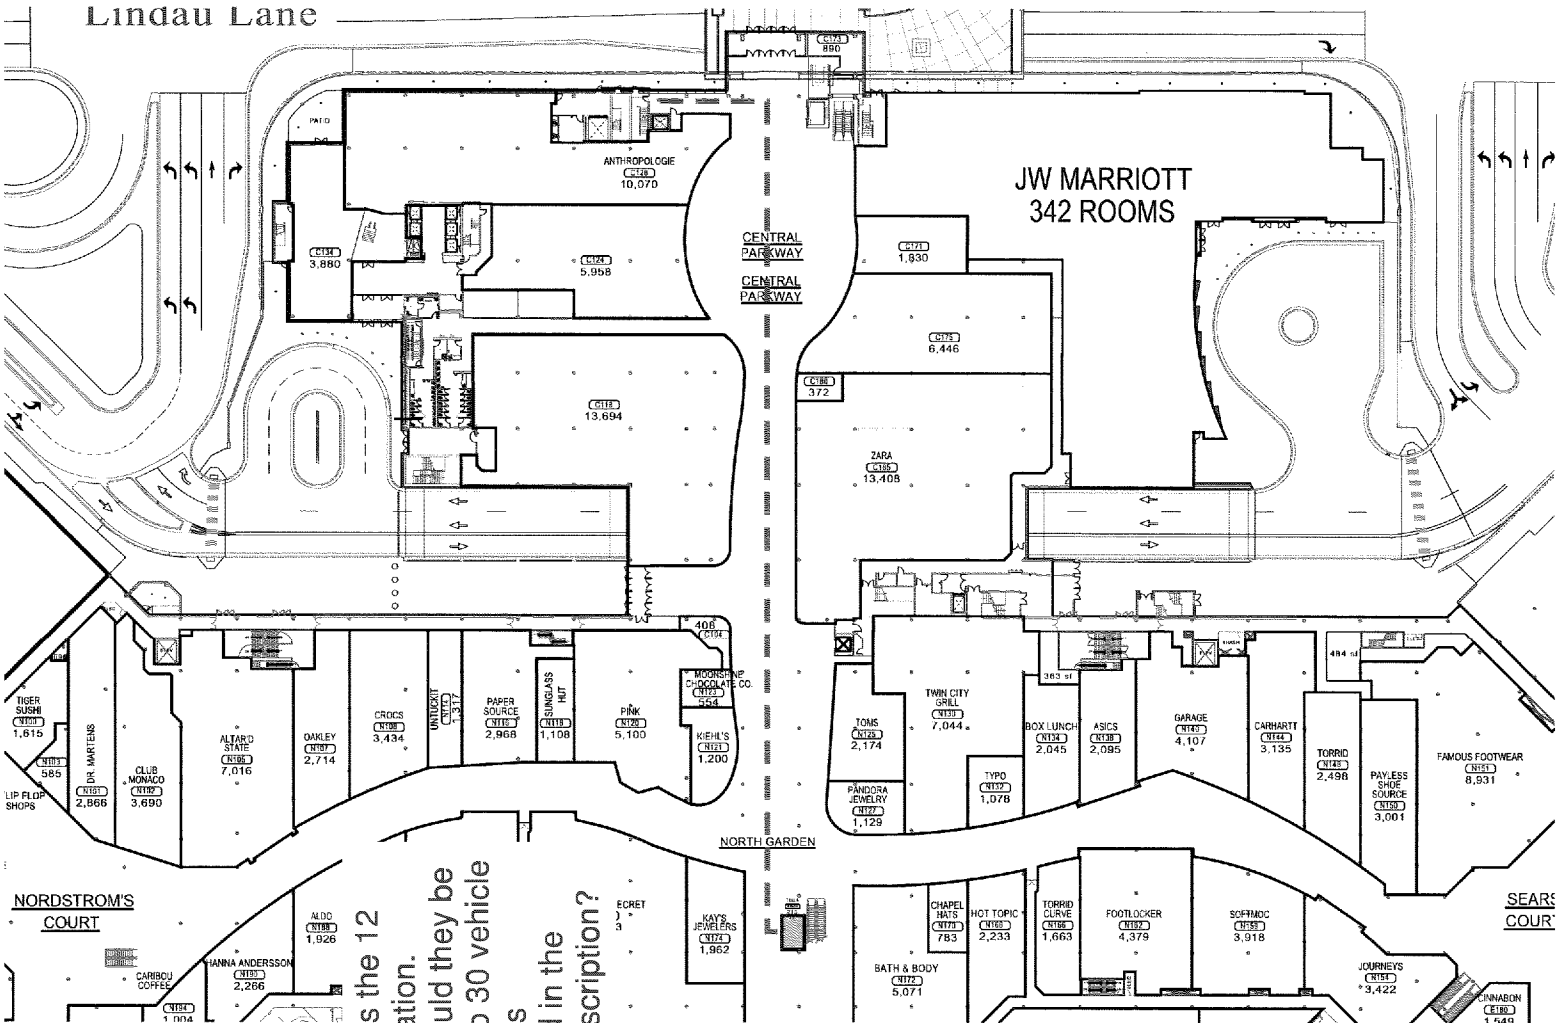


LEVEL 0

This shows the 12 space location. Where would they be if it grew to 30 vehicle capacity as mentioned in the project description?

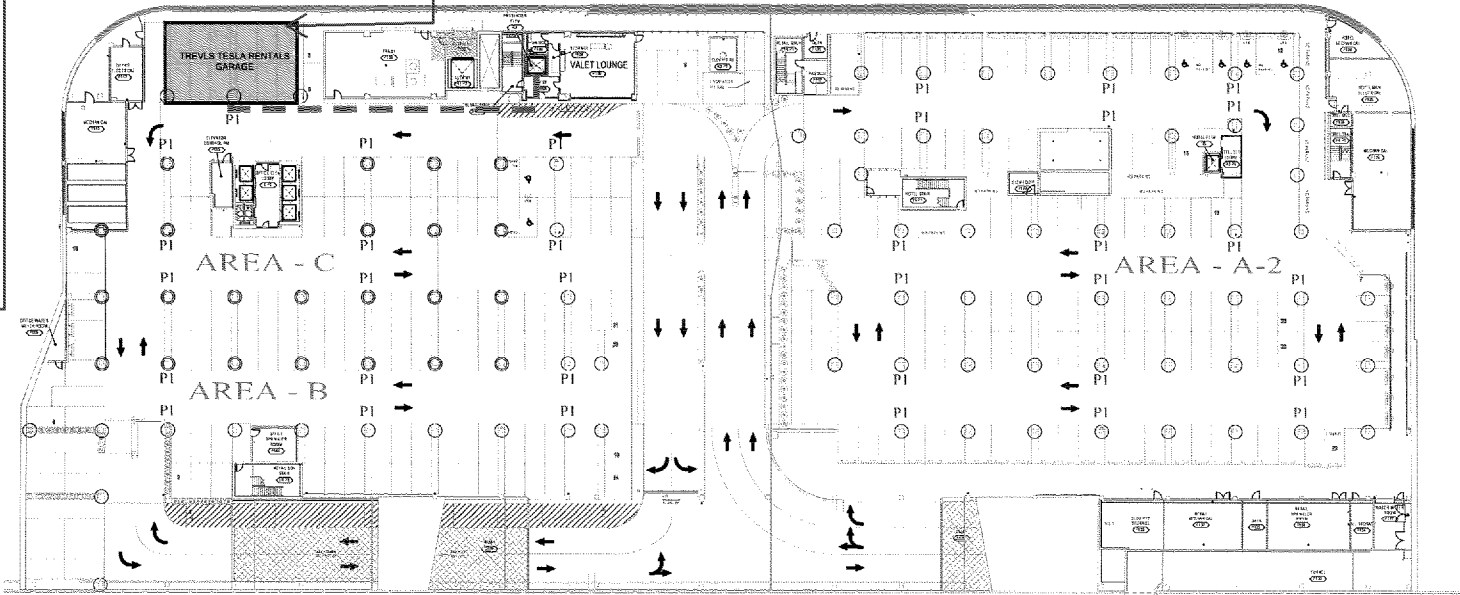

Separate Electrical Permit Required for charging station.

Provide separate disconnect for the charging stations that is easily accessible by the Fire Department.



2131 LINDAU LANE - SUITE 500
BLOOMINGTON, MN 55425

The information in this document is confidential and a proprietary trade secret of the Landlord and may not be copied, distributed, published or disclosed without prior written permission. Landlord retains the right to design, change, alter or modify (without prior written notice) the size and configuration of any or all of the Center or any of the buildings, premises, hallways, malls, corridors, kiosks, tenant spaces or common areas contained therein, including, but not limited to, the identity, size, configuration, location or arrangement of any of the foregoing. This document does not constitute any contract or obligation by the Landlord. Landlord makes no representations or warranties regarding the Center, any premises contained therein, or the accuracy of the information contained in this document. Gross Leasable Area is calculated pursuant to ANSI/BOMA Z65.5-2010 Retail Building Standard. It is the responsibility of Tenant or Tenant's contractor to field verify existing site conditions and dimensions.

DBA Name: TREVLS TESLA RENTALS
Unit No. N1804
Scale: NOT TO SCALE

Requested by: NK
Phone: 952.883.8810
Date: 12/20/2017