
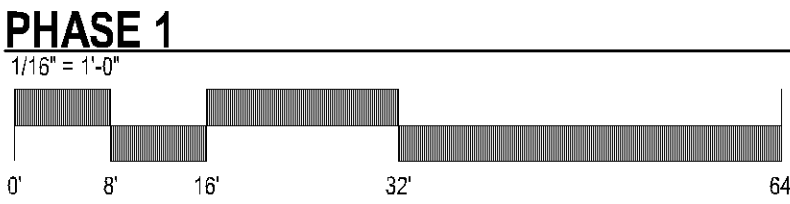


PL201800048
PL2018-48

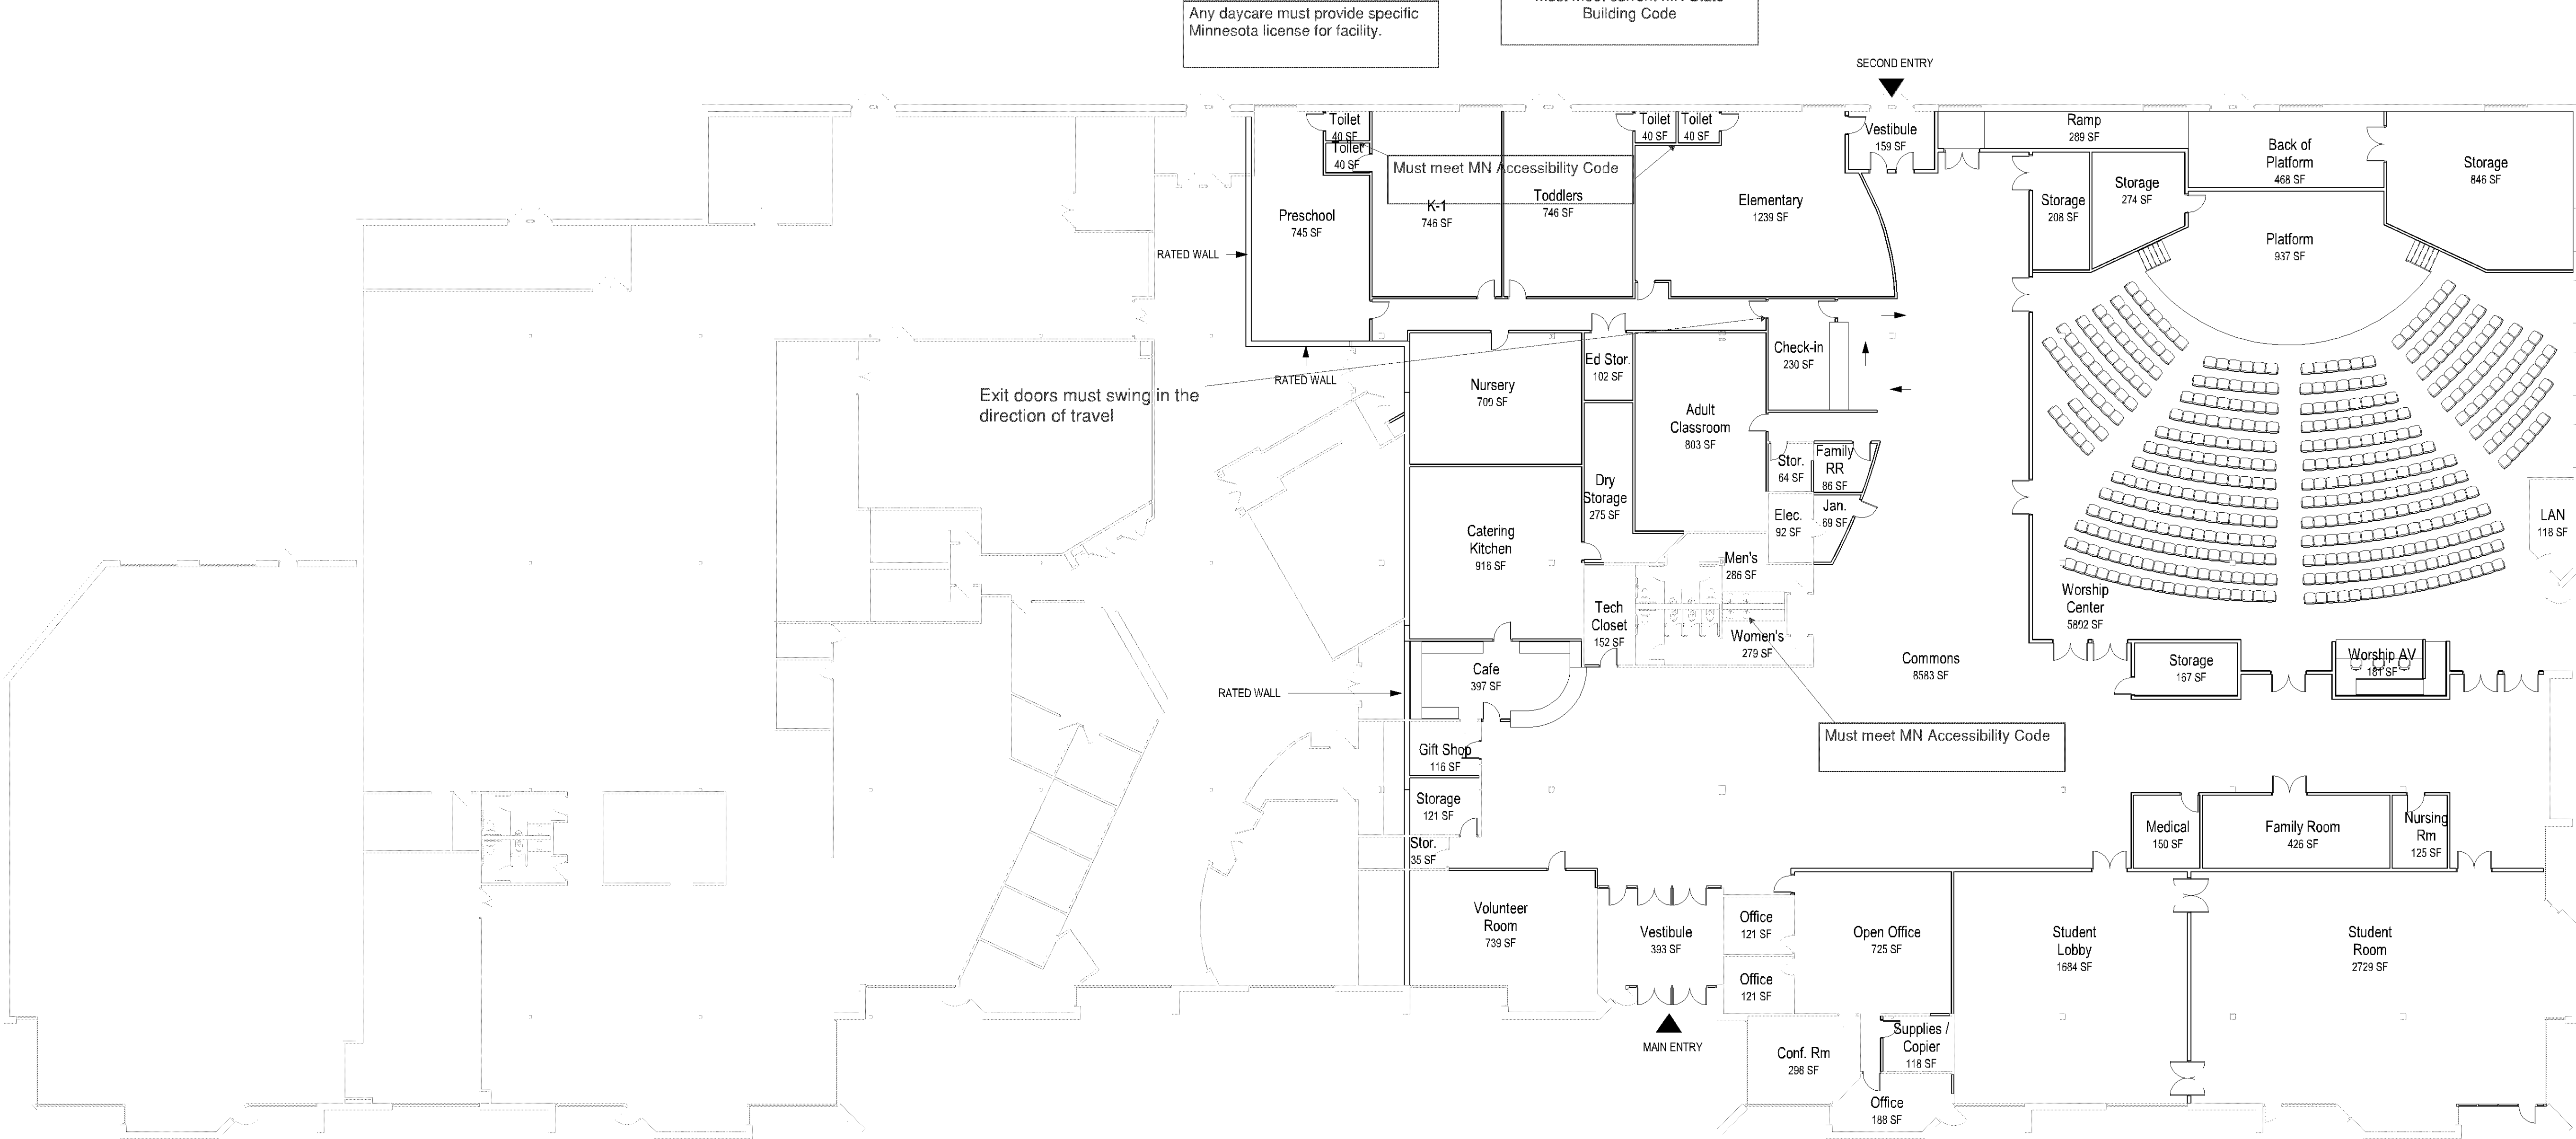

Fire alarm system to meet the requirements of both an A and I occupancy if the the daycare area will be used for more than 1 day a week. Otherwise meet the requirements of an assembly occupancy.

Catering kitchen will require either a type I or type II hood if appliances are capable of cooking foods that produces grease laden vapors.

PL201800048
PL2018-48

