




ep **emanuelson-podas**
consulting engineers

24TH AVENUE SOUTH

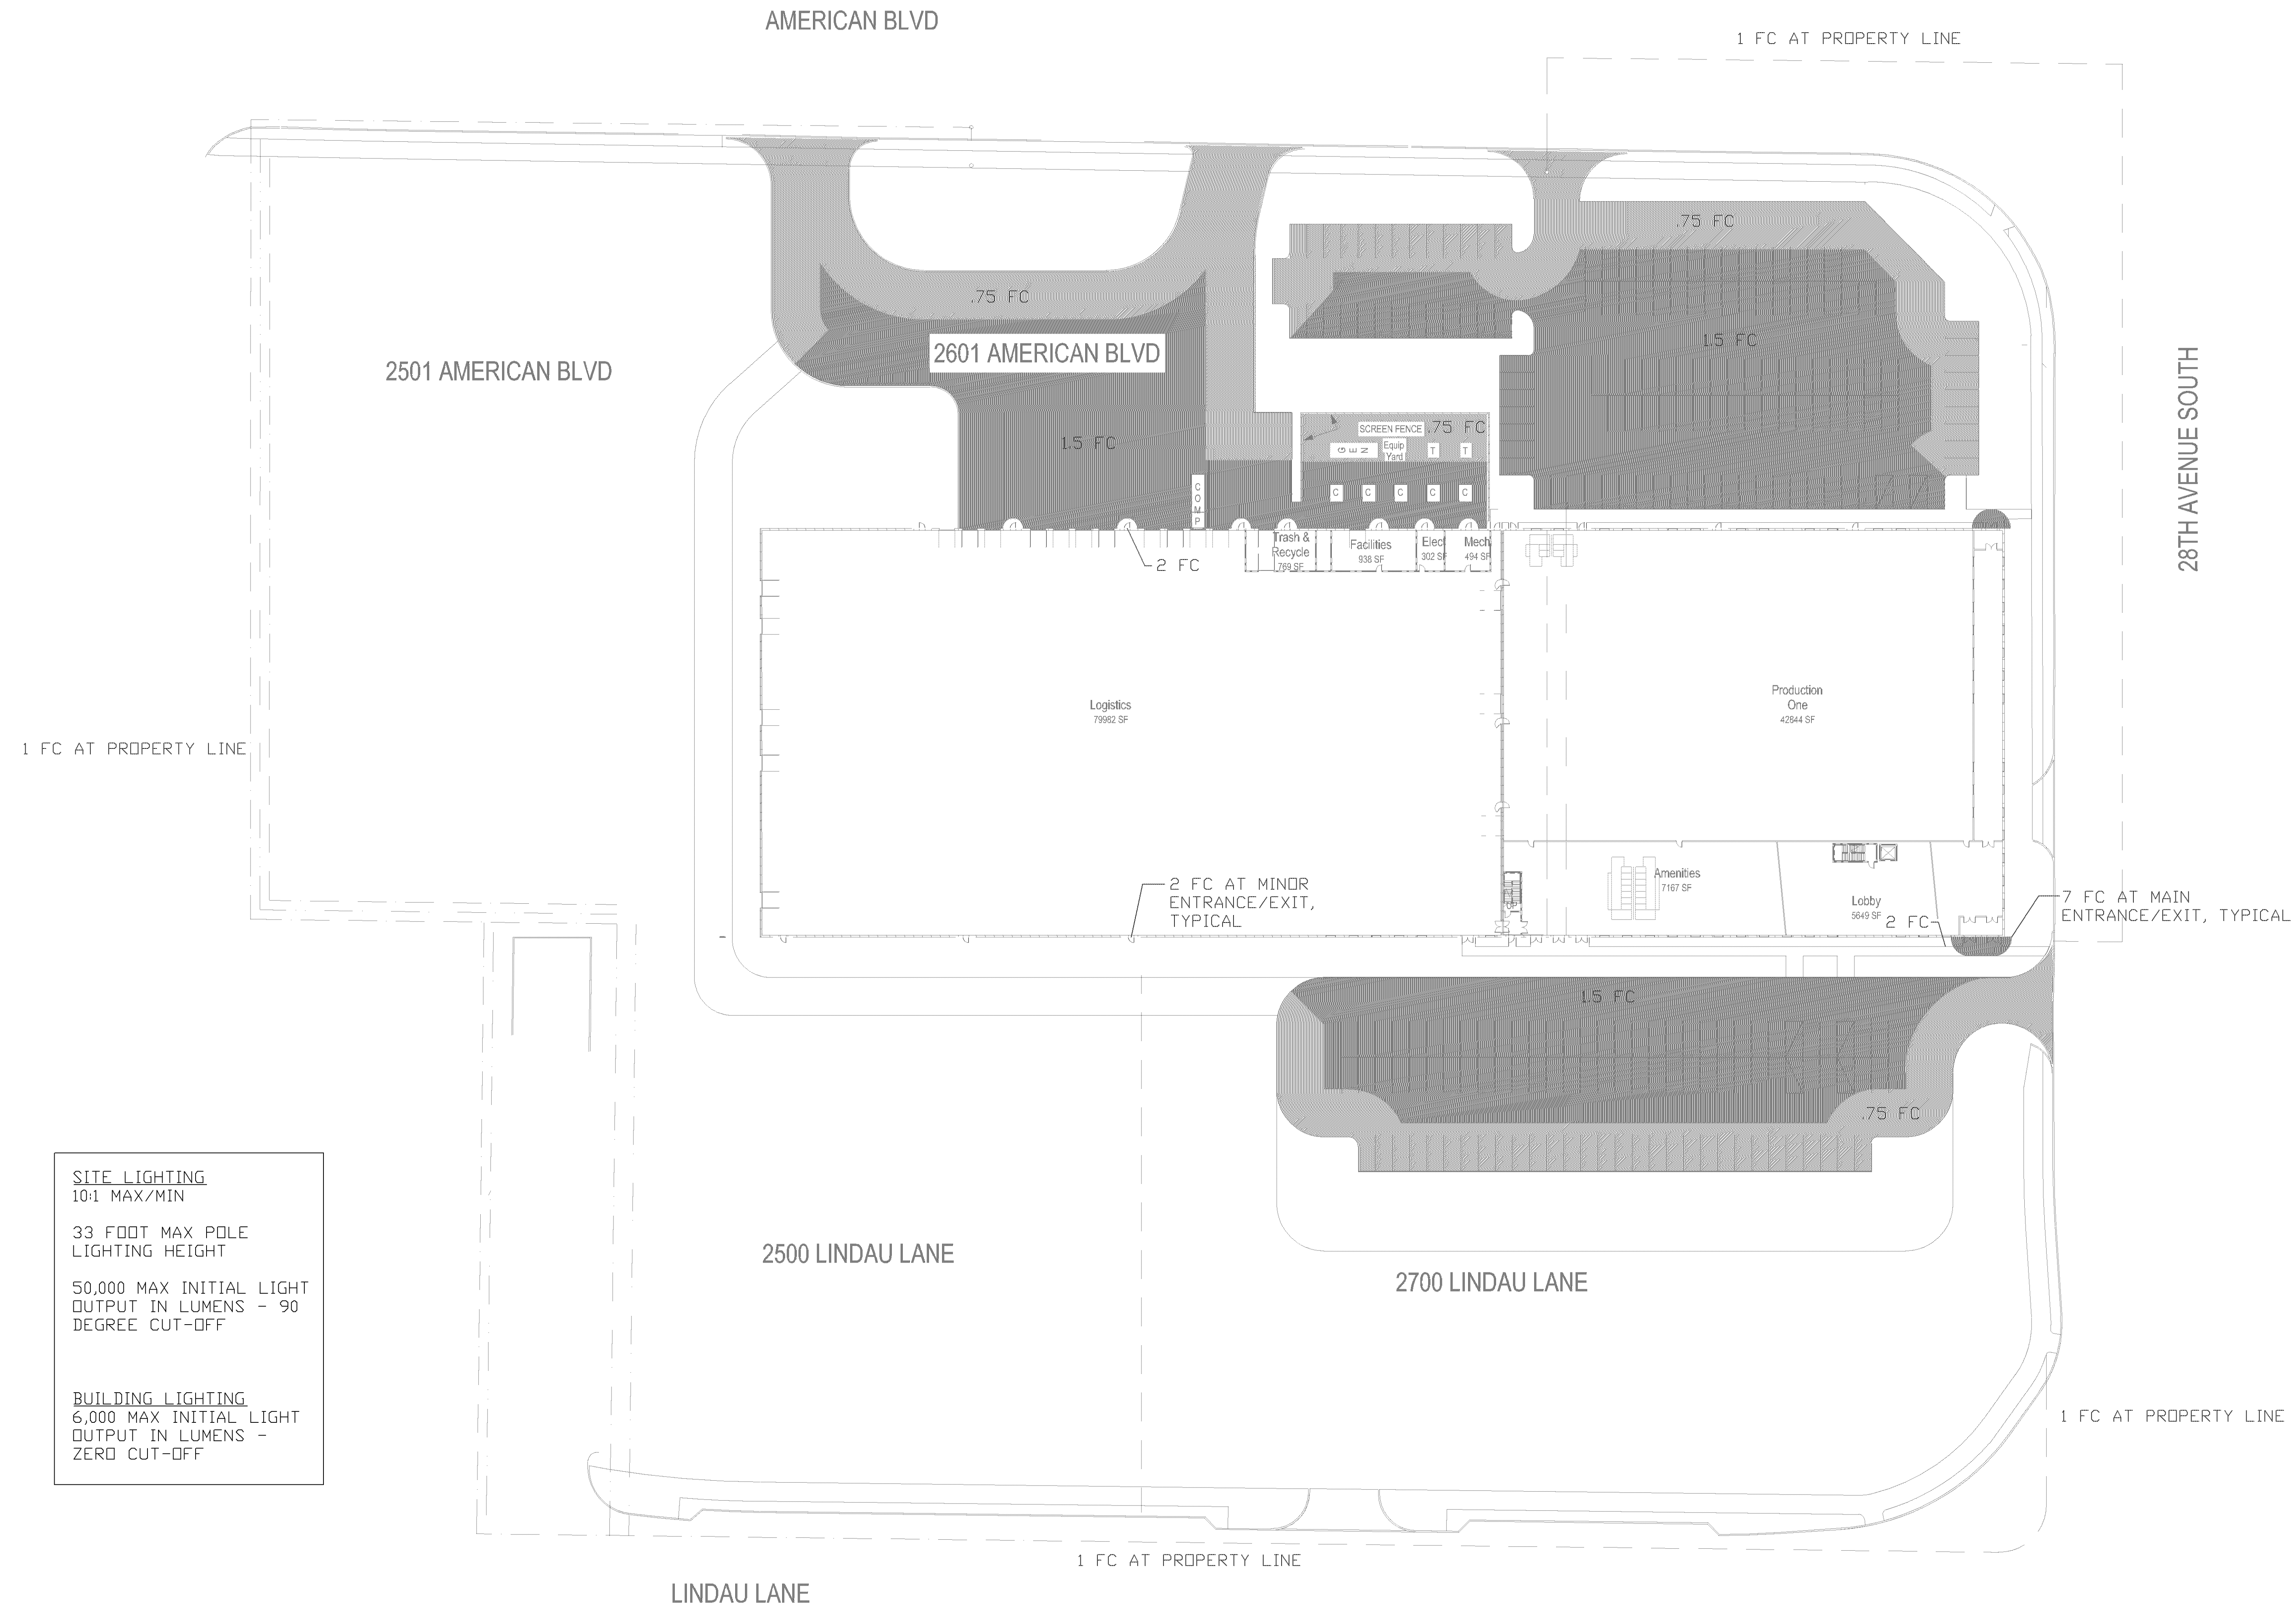

SITE LIGHTING
10:1 MAX/MIN

33 FOOT MAX POLE
LIGHTING HEIGHT

50,000 MAX INITIAL LIGHT
OUTPUT IN LUMENS - 90
DEGREE CUT-OFF

BUILDING LIGHTING
6,000 MAX INITIAL LIGHT
OUTPUT IN LUMENS -
ZERO CUT-OFF

ENERGY USE SHALL COMPLY WITH MINNESOTA ENERGY CODE

PRELIMINARY NOT FOR
CONSTRUCTION

Revisions		
No.	Date	Description

Project Information	
Phase:	Date: 03/20/2019
Project No.: 4268.0000	PIC / AIC:

SICK FACILITY

Sheet Title

LIGHTING REQUIREMENTS PLAN

Sheet Number Current Revision

E.01

Copyright © 2018 by Curington Group Architecture, Inc. All Rights Reserved

SICK Campus - Phase One - Lighting Requirements Plan

Bloomington, Minnesota