
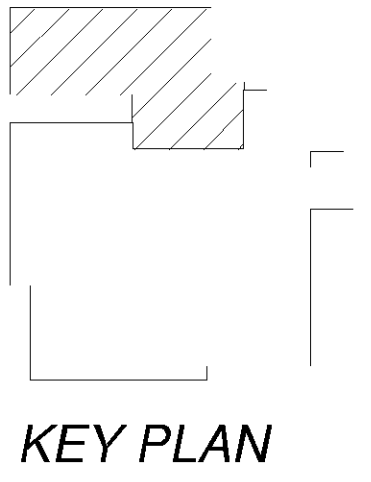


The purpose/use of the training rooms has a significant impact on the overall parking requirement. If the training room is used for on-site employees, we would calculate the space as office. If the rooms are used for trainings where the participants are not located at site, we would calculate the space as assembly, which has a higher parking requirement.

As office, the preliminary parking requirement is 120 stalls. As assembly, the parking requirement increases to 152 stalls. Either way, additional parking must be addressed with the plan submittal through additional parking provided on site and/or proof of parking.

1 OVERALL FLOOR PLAN
SCALE: 1/16" = 1'-0"



This drawing was prepared solely for the use of Verizon Wireless and shall not be used by anyone other than Verizon Wireless employees, affiliates, and vendors without the written consent of Verizon Wireless. Any other use of this drawing is prohibited.

MORRISON HERSHFIELD
MISSION CRITICAL
1455 LINCOLN PARKWAY, SUITE 500
ATLANTA, GA 30346
TEL: 770.379.8500 FAX: 770.379.8501
WWW.MORRISONHERSFIELD.COM

DO NOT SCALE DRAWING. DIMENSIONS MUST BE TAKEN FROM DIMENSIONS AND NOTED DIMENSIONS OF THE DRAWING. DIMENSIONS TO CENTERLINE OF WALLS UNLESS NOTED OTHERWISE. DIMENSIONS TO FACE UNLESS NOTED OTHERWISE. DIMENSIONS TO CENTERLINE OF WALLS UNLESS NOTED OTHERWISE. DIMENSIONS TO FACE UNLESS NOTED OTHERWISE. DIMENSIONS TO CENTERLINE OF WALLS UNLESS NOTED OTHERWISE. DIMENSIONS TO FACE UNLESS NOTED OTHERWISE.

SUBCONSULTANT

verizon
BLOOMINGTON MSC EXPANSION
10801 BUSH LAKE ROAD
BLOOMINGTON, MN.


REV	DESCRIPTION	DATE
-----	-------------	------

NETWORK COMPLIANCE SUBMITTALS	DATE
ISSUED FOR PRELIMINARY REVIEW	04/24/2020

PROJECT NO:	200174500	STAMP
CAD DWG FILE:	A110	
DESIGNED BY:	JP	
DRAWN BY:	KNC	
CHECKED BY:	JP	
COPYRIGHT:	APRIL 2020	

SHEET TITLE
OVERALL FLOOR PLAN

SHEET NUMBER
A110

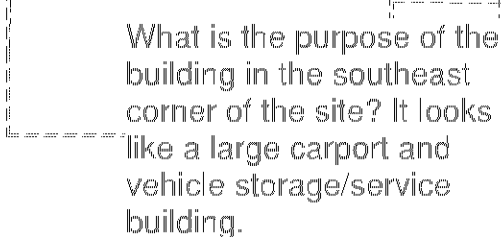

Fire alarm, annunciator panels and Knox box location(s) to be determined by the Fire Prevention Division.



△ REV	DESCRIPTION	DATE
-------	-------------	------

NETWORK COMPLIANCE SUBMITTALS	DATE
ISSUED FOR PRELIMINARY REVIEW	04/24/2020



SHEET TITLE

SITE PLAN

SHEET NUMBER **A100**

SHEET NUMBER **A210**

KEY PLAN

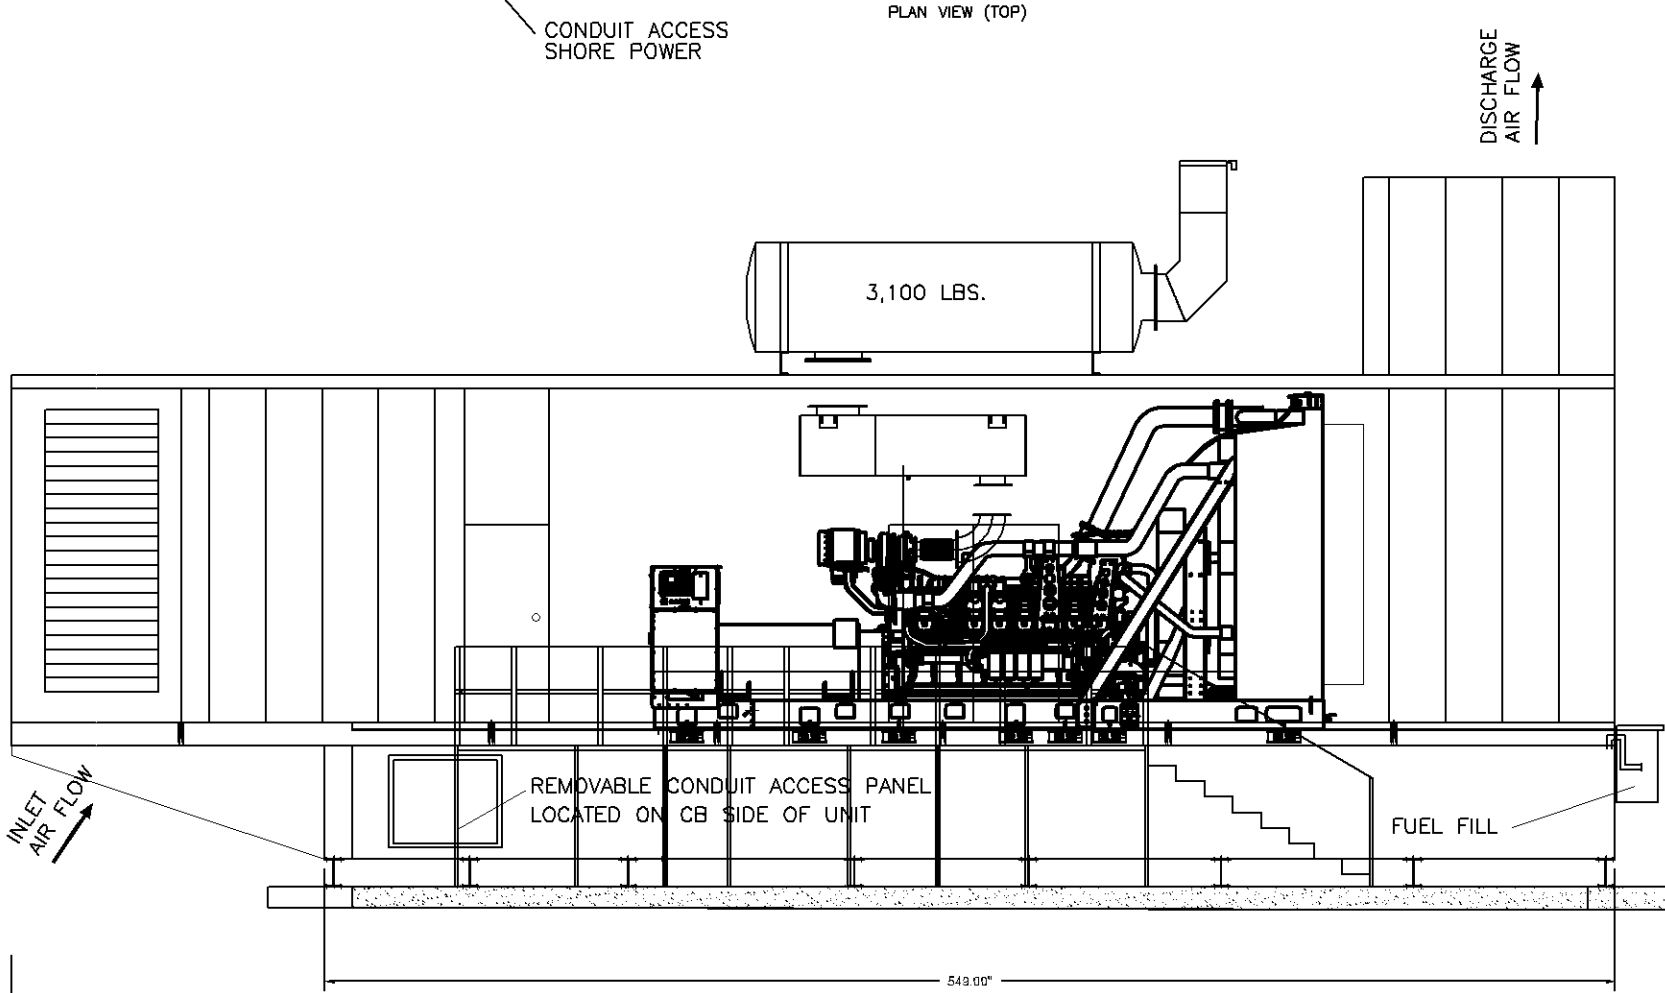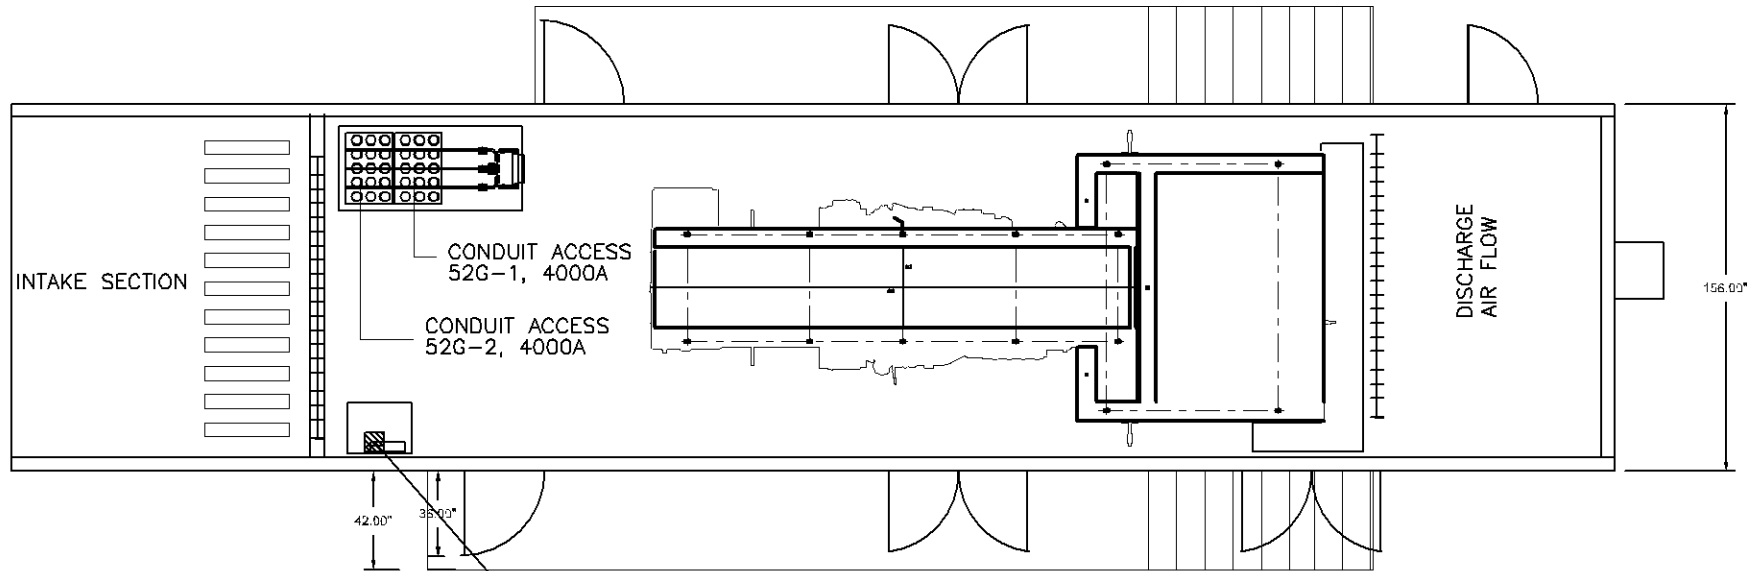

SOUND ATTENUATED ENCLOSURE PACKAGE CAT 3516E

RESISTIVE RADIATOR MOUNTED LOAD BANK

FREE STANDING DUAL 4000A BREAKER CUBICLE SHOWN

65 dBA @ 23' WALK AROUND SOUND ATTENUATED ENCLOSURE


- ENCLOSURE DESIGN
- 125 MPH WIND RIGIDITY
 - ROOF CAPACITY 200LBS/SQ FT
 - RAIN CAPACITY 4 INCHES PER HOUR
 - MARINE GRADE ALUMINUM PANEL CONSTRUCTION
 - EXTERIOR HARDWARE STAINLESS STEEL
 - FORMED AND BOLTED PANEL
 - INSULATED WALL AND CEILING PANELS
 - INTERIOR ALUMINUM PERFORATED LINING

- UL 2085 FUEL BASE TANK
- 10,000 GALLON CAPACITY
 - 110% RUPTURE BASIN

SHIPPING SECTION
7,800 LBS.

SHIPPING SECTION
75,000 LBS.

SHIPPING SECTION
48,000 LBS.

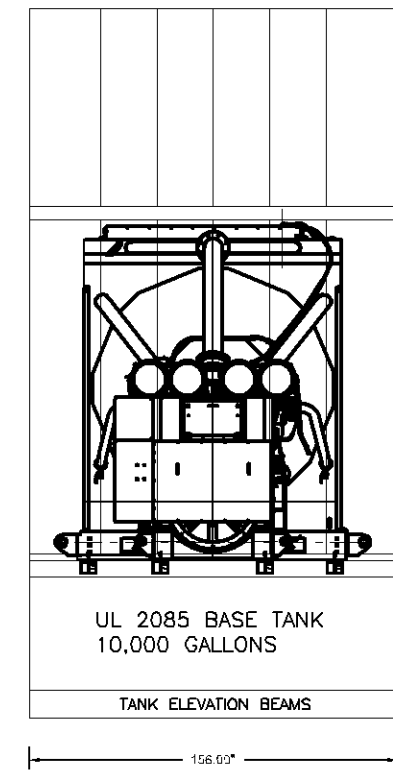

PRELIMINARY ONLY, NOT FOR CONSTRUCTION

REV DESCRIPTION		DATE	INITIALS	REV