

Entire space(s) shall have fully Code complying sprinkler protection.

Building/property shall be adequately signed for emergency response.

The sprinkler system may need to be upgraded in the space depending on the amount of additional plastics/combustible material.



21476 Grenada Avenue Lakeville, MN 55044 Office Main: 952.469.9444
Cell/Direct: 612-708-5281 www.CERRON.com

Must meet 2020 MN
State Building Code

Must meet 2020 MN
Accessibility Code.

Building plans must
be signed by a MN
licensed architect.

SAC review by MET
council will be required.


Plumbing fixture count shall
meet requirements of Table
2902.1 of 2020 MN Building
Code. Based on number of
occupants at least 2 restrooms
may be required.

Where plumbing fixtures are
required, separate facilities shall
be provided for each sex.

A mop sink is required.

* Added extra
electrical outlet

Provide a detailed code
analysis with the plans.

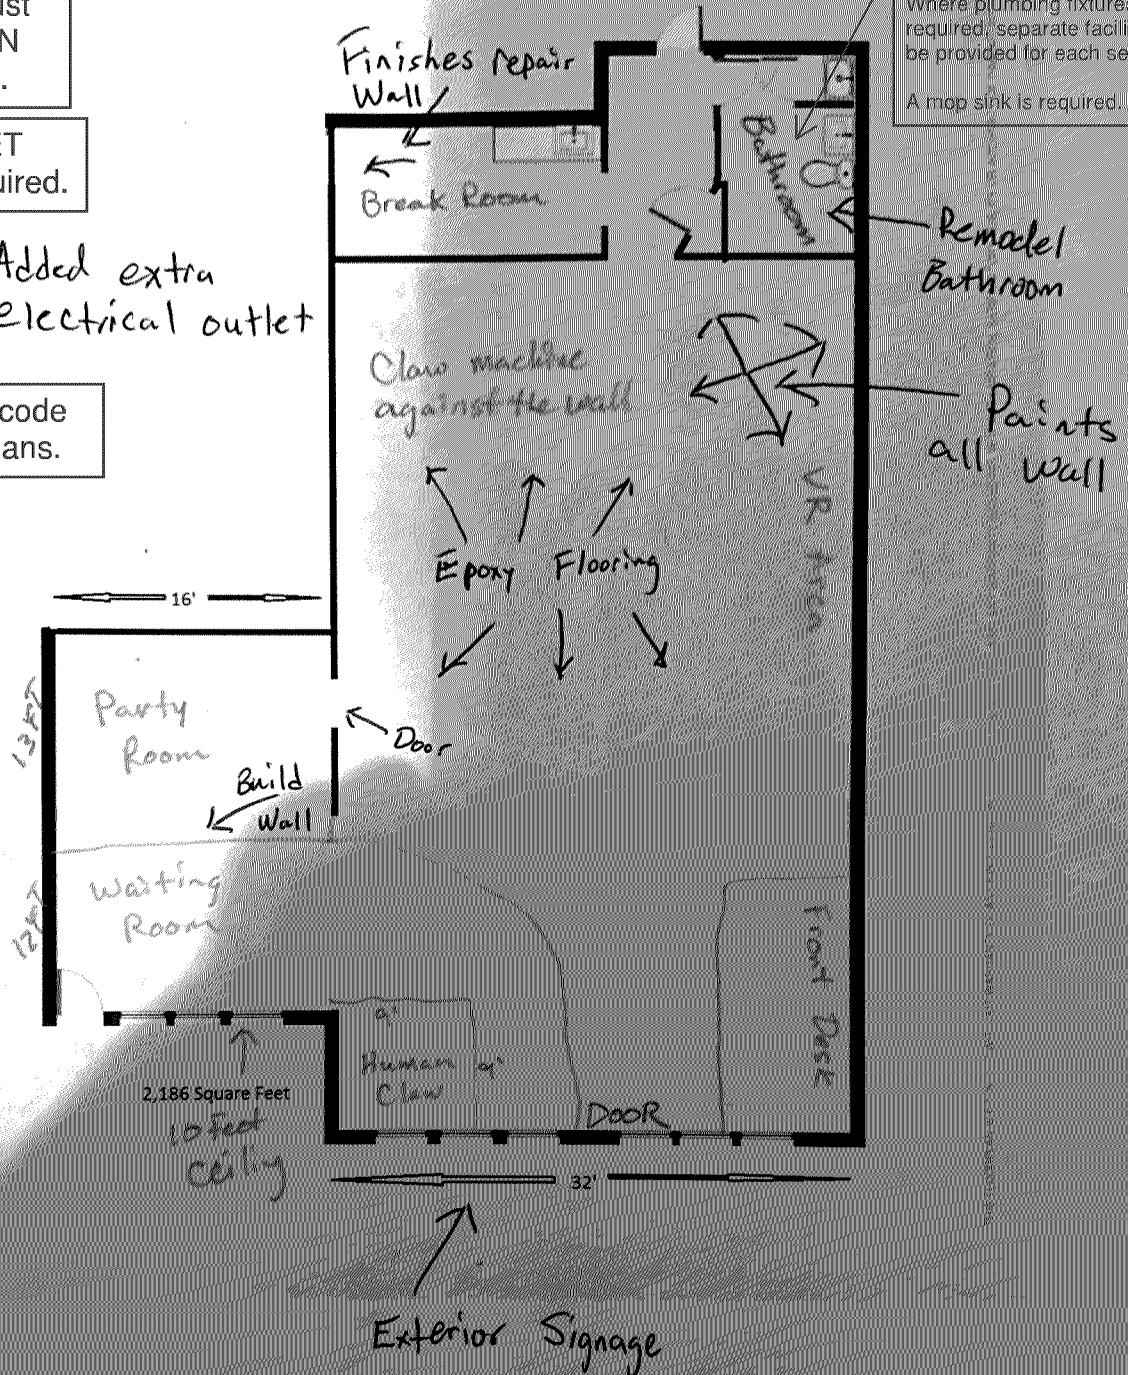

21476 Grenada Avenue Lakeville, MN 55044 Office Main: 952.469.9444
Cell/Direct: 612-708-5281 www.CERRON.com