




Luminaire Schedule							
Symbol	Qty	Type	Mounting Height	Lum. Watts	Luminaire Lumens	LLF	Description
●○○○	4	P1	33	247.49	43655	0.810	OPF-L-A20-740-T5W
●○○○	12	P2	33	247.49	43655	0.810	OPF-L-A20-740-T5W
●○○○	5	P3	33	247.49	44064	0.810	OPF-L-A20-740-T2M
●○○○	3	P4	33	247.49	42180	0.810	OPF-L-A20-740-T4W
●○○○	11	W1	18	106.6	9140	0.810	101L-32L-1000-NW-G1-4

Calculation Summary						
Project: Calculations						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
Circulation	Fc	3.76	6.7	1.6	2.35	4.19
Customer Parking	Fc	4.21	7.9	2.2	1.91	3.59
Main Entrance	Fc	3.98	6.5	1.9	2.09	3.42

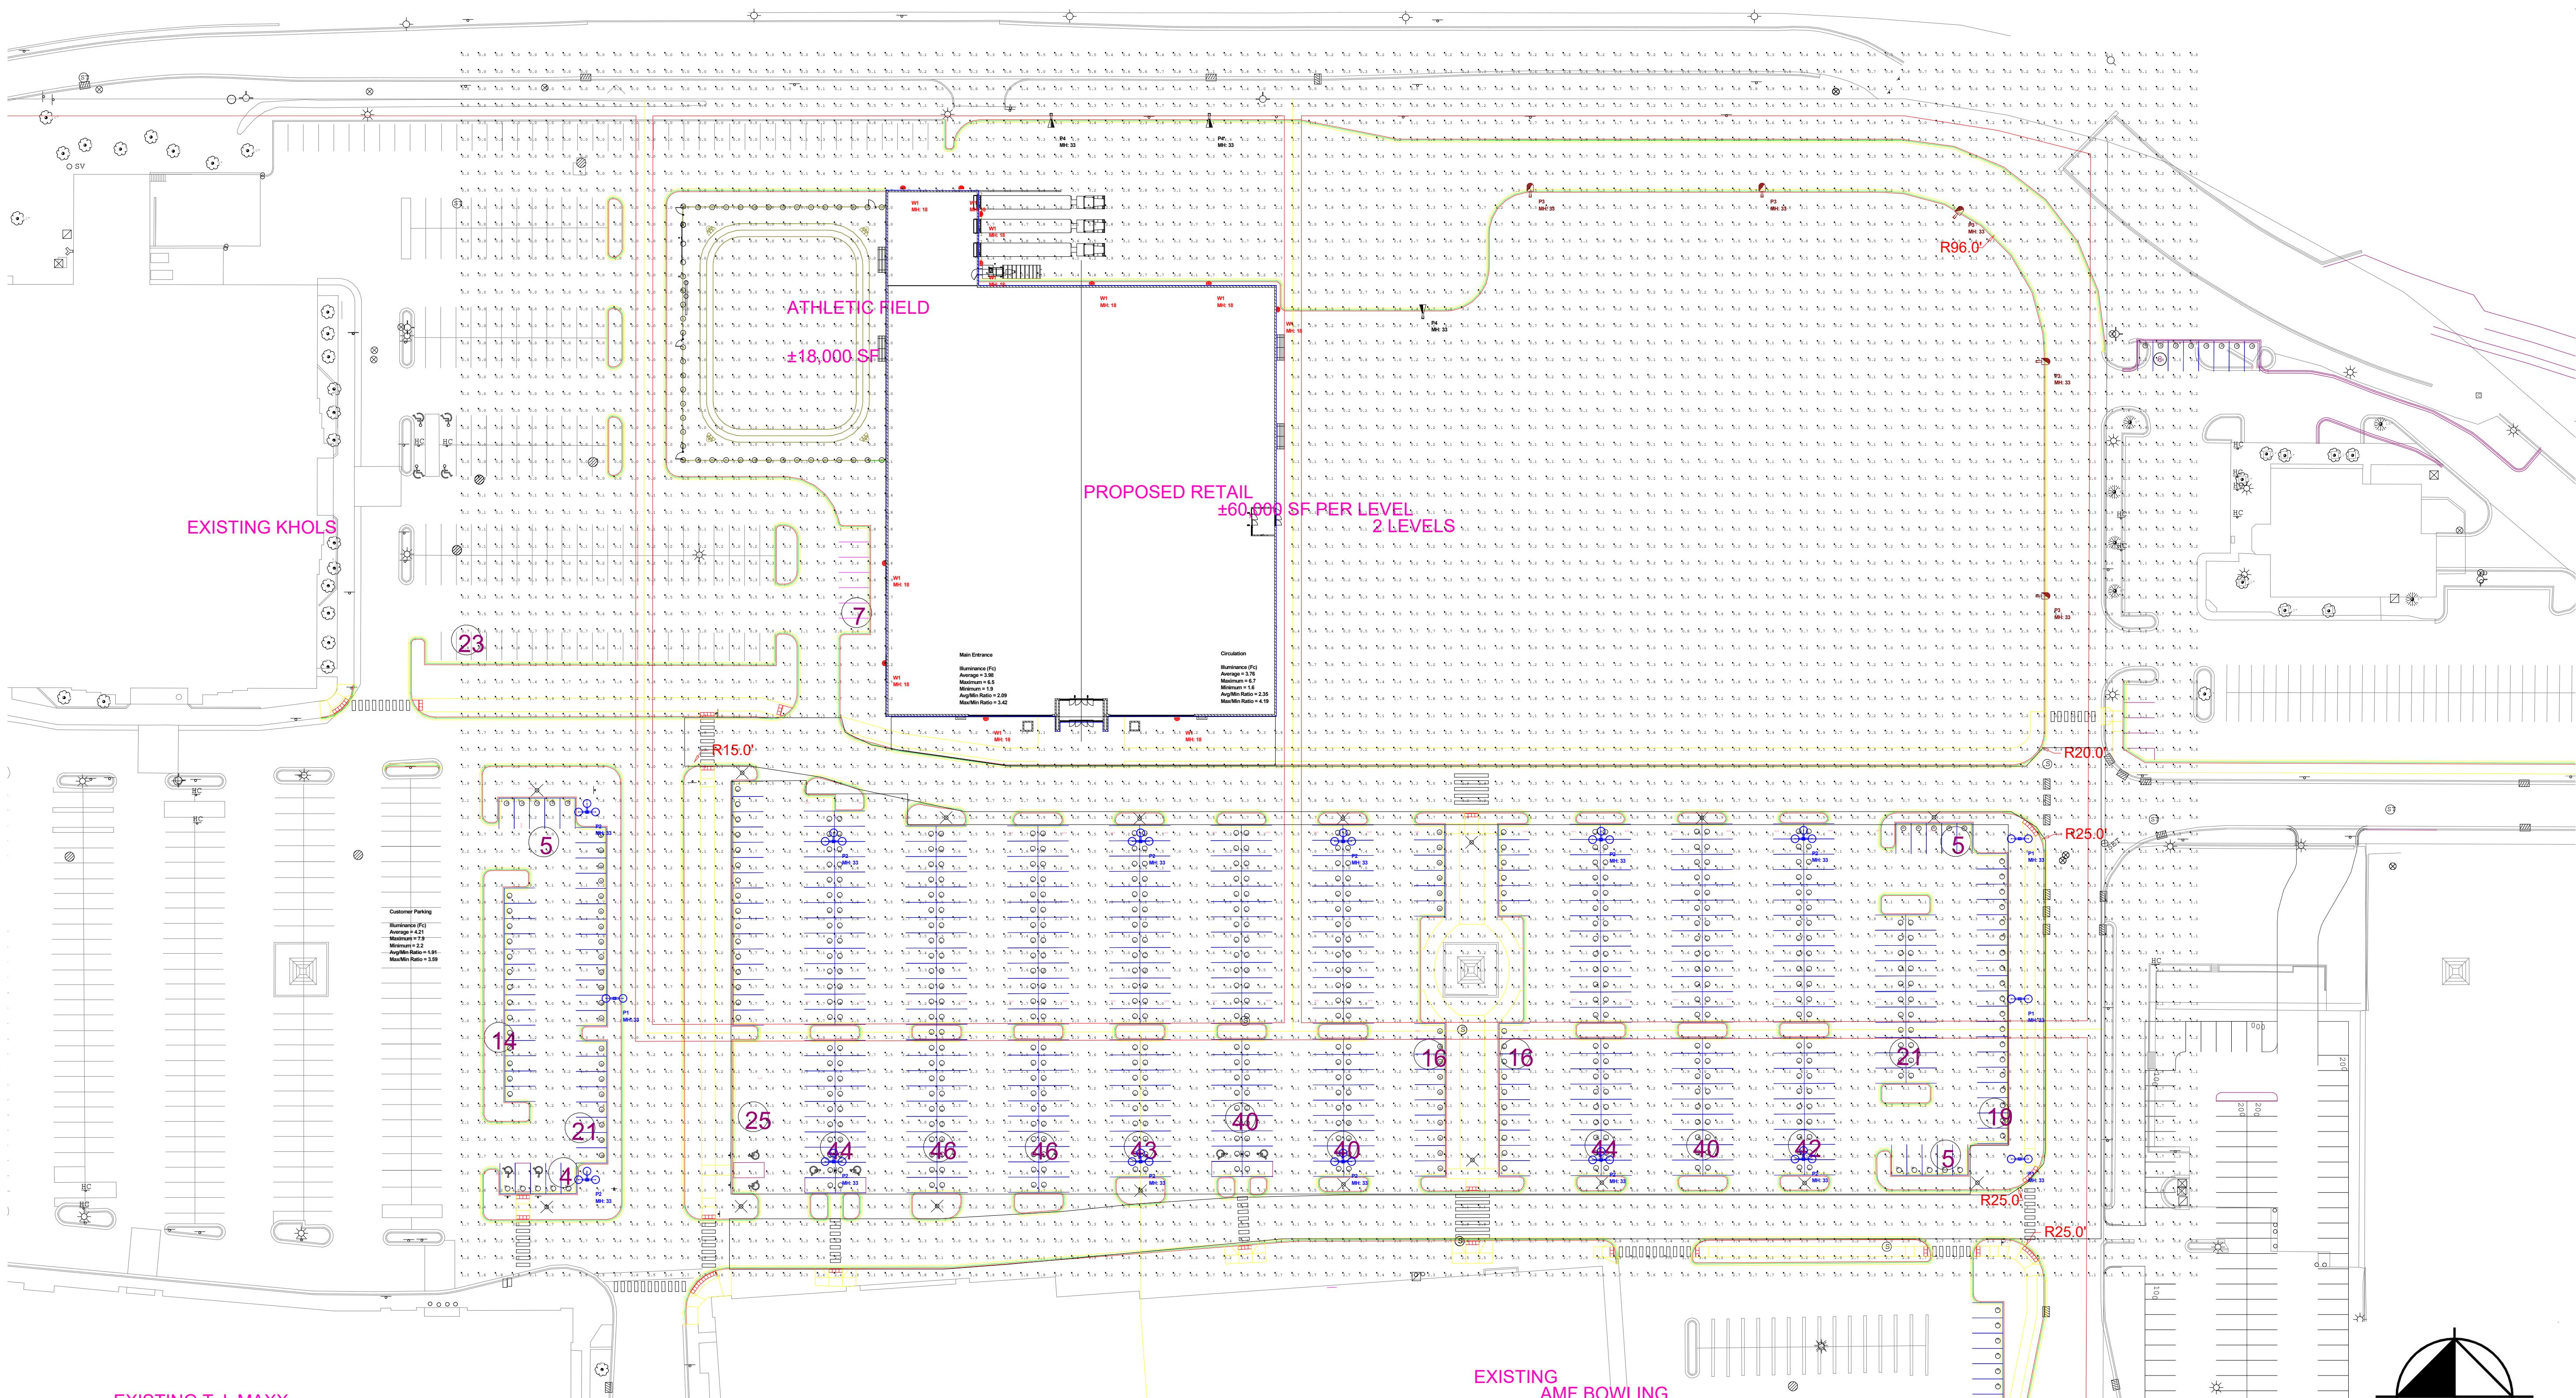

**DISCLAIMER:** Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. Actual performance of any manufacturer's luminaire may vary due to changes in electrical voltage, tolerance in LEDs and other variable field conditions. Calculations do not include obstructions such as buildings, curbs, landscaping or any other architectural elements unless noted.

Fixture nomenclature to be finalized by engineer and/or architect. This drawings is for photometric evaluation purposes only and should not be used as a construction document or as a final document for ordering product.

Designed By: K. Tomczak

Checked By: Rob Chasse

Date: 6/13/2024

Southtown Site

MAINTAINED (.81 LLF)