


Symbol	Qty	Type	Mounting Height	Lum. Watts	Luminaire Lumens	LLF	Description
	4	P1	33	247.49	43655	0.810	OPF-L-A20-740-T5W
	13	P2	33	247.49	43655	0.810	OPF-L-A20-740-T5W
	5	P3	33	247.49	44064	0.810	OPF-L-A20-740-T2M
	3	P4	33	247.49	42180	0.810	OPF-L-A20-740-T4W
	9	P5	33	324.39	57454	0.810	OPF-L-A26-740-T5N
	22	W1	12, 18	106.6	9140	0.810	101L-32L-1000-NW-G1-4


Calculation Summary						
Project: Calculations						
Label	Units	Avg	Max	Min	Avg/Min	Max/Min
Circulation	Fc	5.34	10.2	2.2	2.43	4.64
Customer Parking	Fc	5.11	10.9	2.2	2.32	4.95
Main Entrance	Fc	7.20	13.9	3.8	1.89	3.66

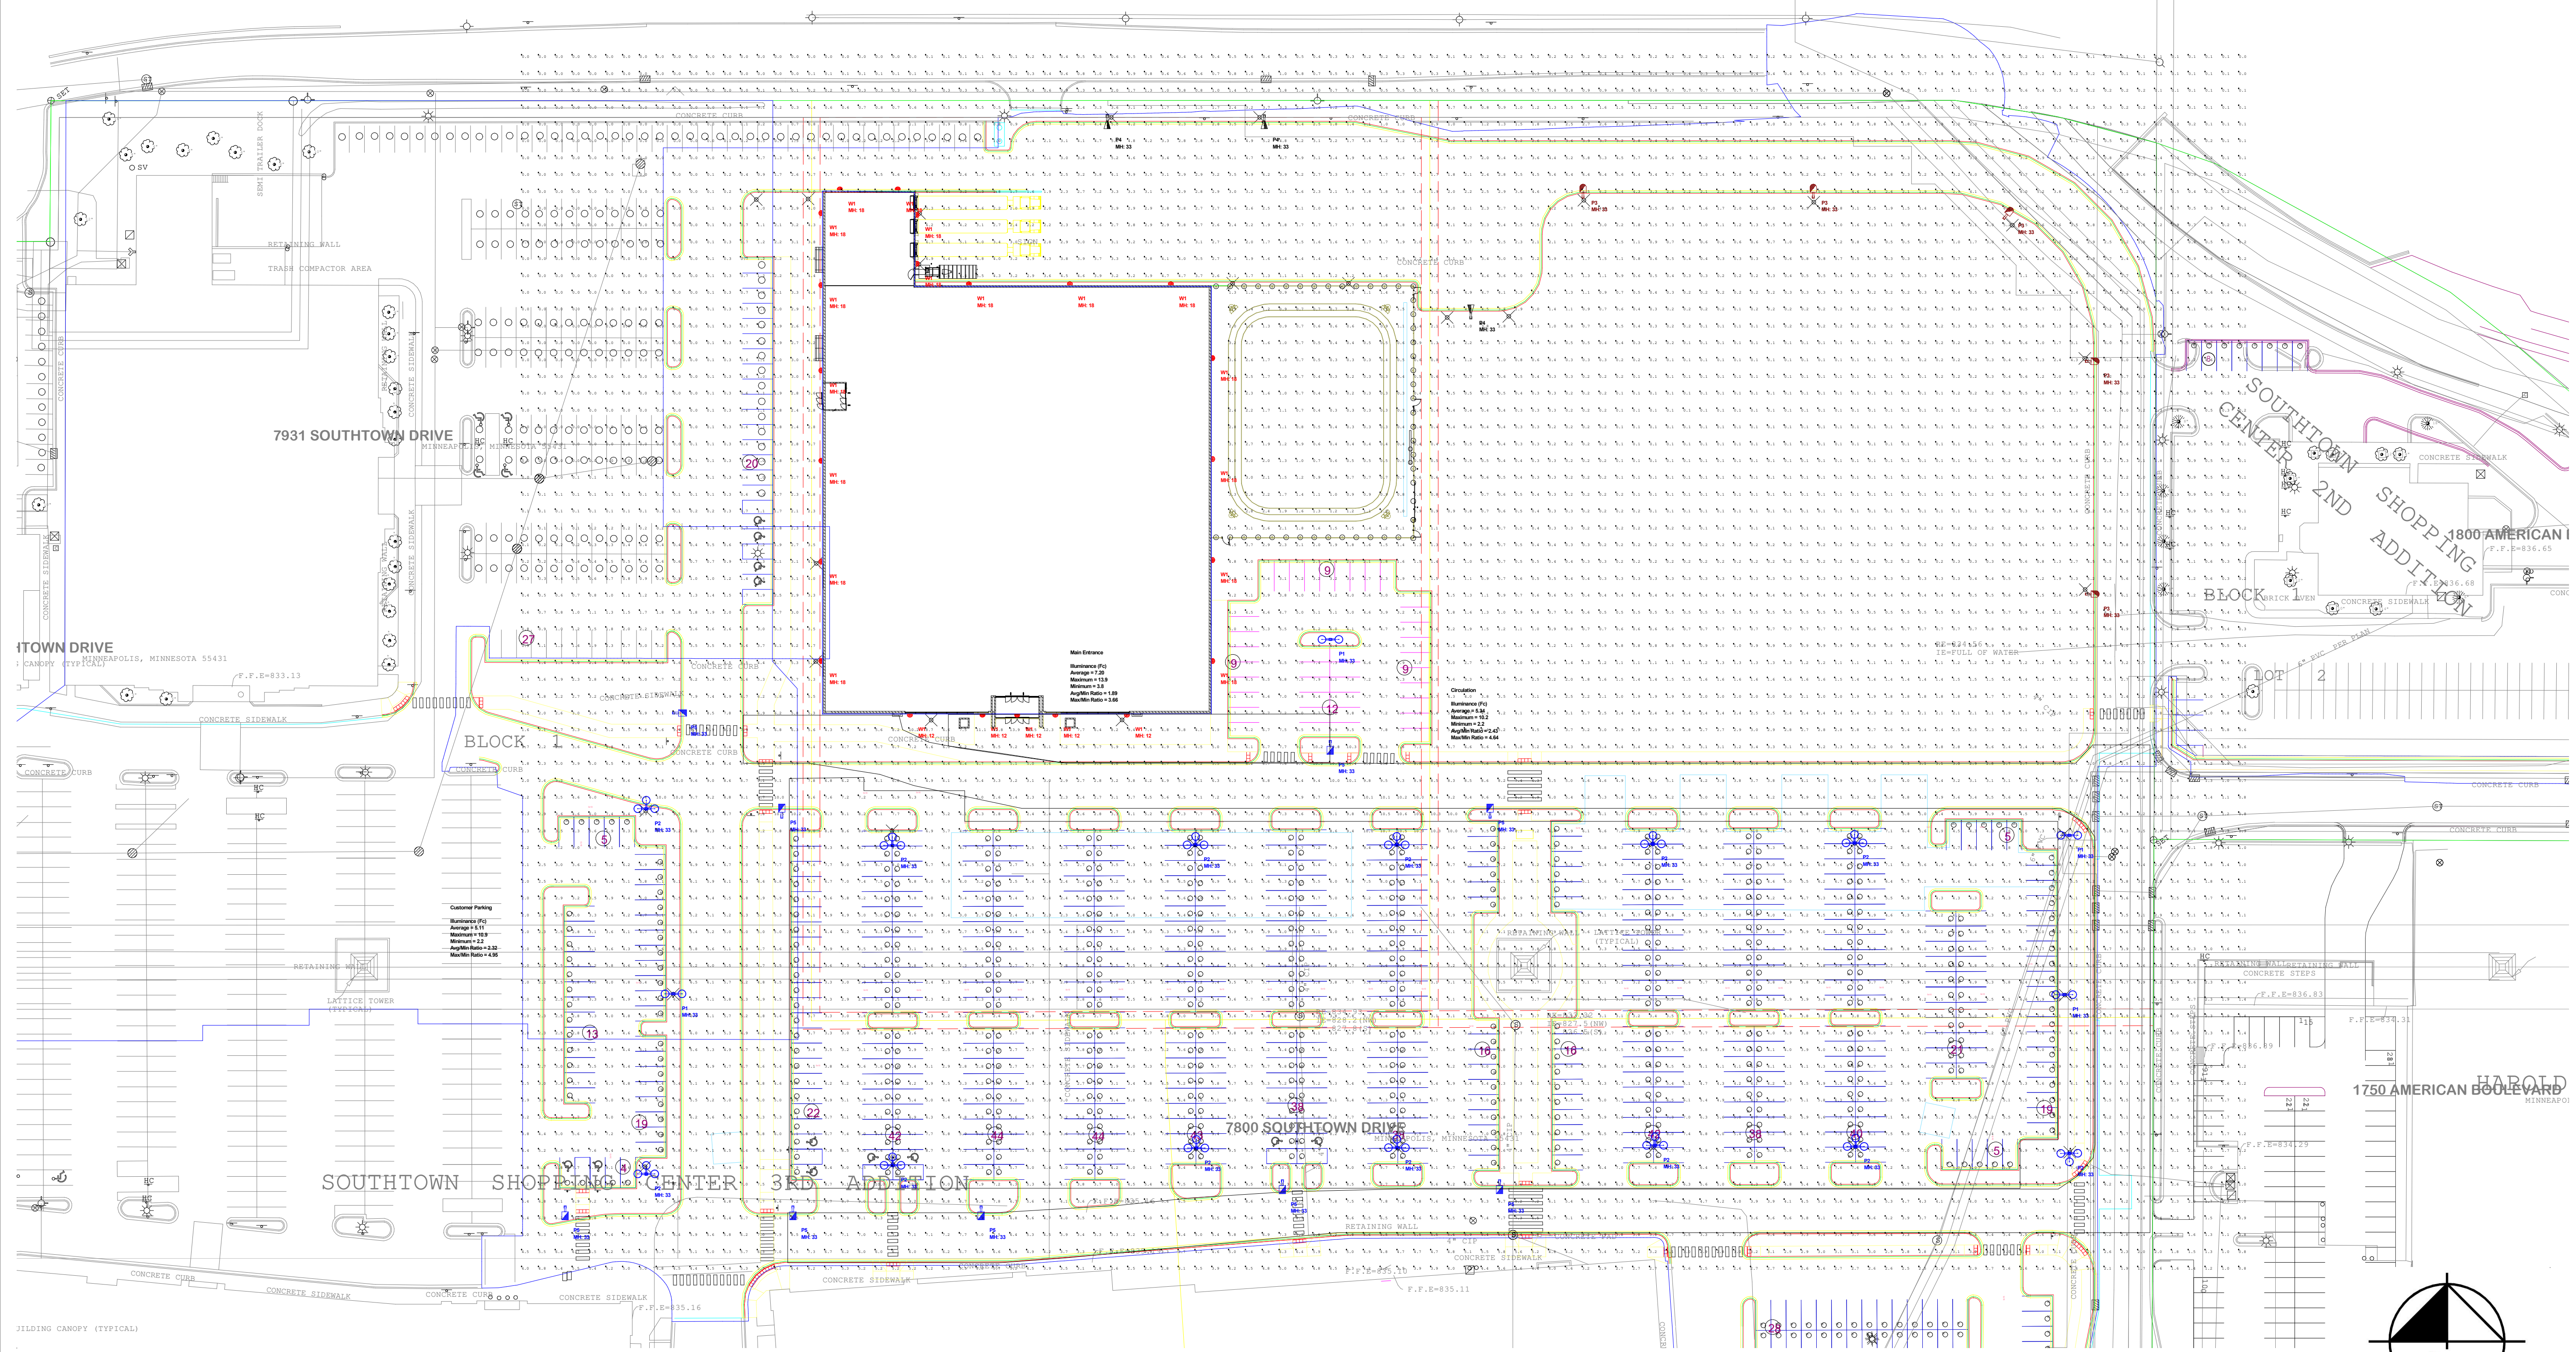

**DISCLAIMER:** Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. Actual performance of any manufacturer's luminaire drawings is for photometric evaluation purposes only and may vary due to changes in electrical voltage, tolerance in LEDs and other variable field conditions. Calculations do not include obstructions such as buildings, curbs, landscaping or any other architectural elements unless noted.

Fixture nomenclature to be finalized by engineer and/or architect. This should not be used as a construction document or as a final document for ordering product.

Illuminated  
Design Service

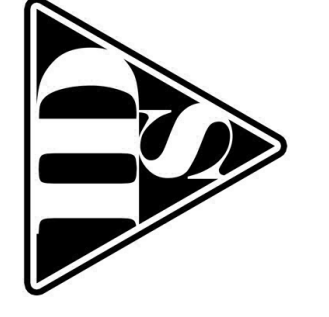

**PULSE**  
never ordinary

Designed By: K. Tomczak  
Checked By: Rob Chasse  
Date: 7/25/2024  
Scale: 1" = 50'

Southtown Site  
**MAINTAINED (.81 LLF)**